INSTALLATION MANUAL



TRUE COMFORT ||||

This manual covers the following models:

• T805



Thermostat Applications Guide

Description	
Gas or Oil Heat	Yes
Electric Furnace	Yes
Heat Pump (No Aux. or Emergency Heat)	Yes
Heat Pump (with Aux. or Emergency Heat)	No
Multi-stage Systems	No
Heat Only Systems	Yes
Cool Only Systems	Yes
Millivolt	Yes

Power Type

Battery Power
Hardwire (Common Wire)
Hardwire (Common Wire) with Battery Backup

Table of Contents Page 2 **Installation Tips** 3 Thermostat Quick Reference 4 Subbase Installation 5 Wiring 6 Wiring Diagrams 7, 8, 9 Technician Setup Menu 10 Mounting and Battery Installation 11, 12, 13 Programming The Thermostat 14 **Specifications**

Una versión española de este manual puede ser descargada en www.pro1iaq.com

A trained, experienced technician must install this product.


Carefully read these instructions. You could damage this product or cause a hazardous condition if you fail to follow these instructions.

Need Help?

For assistance with this product please visit http://www.pro1iaq.com or call Pro1 Customer Care toll-free at 888-Pro1iaq (776-1427) during normal business hours (Mon-Fri 9 AM - 6 PM Eastern)

Wall locations

The thermostat should be installed approximately 4 to 5 feet above the floor. Select an area with average temperature and good air circulation.

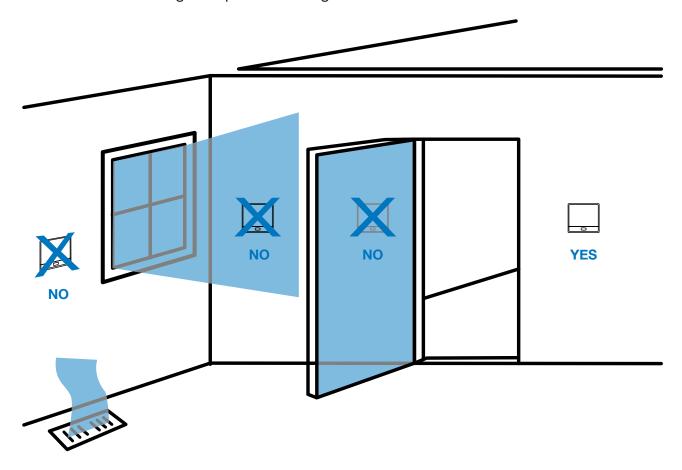

Do not install thermostat in locations:

- Close to hot or cold air ducts
- That are in direct sunlight
- With an outside wall behind the thermostat
- In areas that do not require conditioning
- Where there are dead spots or drafts (in corners or behind doors)
- Where there might be concealed chimneys or pipes


PRO1 Tip

Pick an installation location that is easy for the user to access. The temperature of the location should be representative of the building.

THERMOSTAT QUICK REFERENCE

Getting to know your thermostat



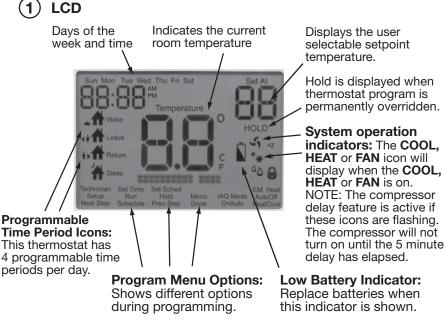


- ② Glow in the Dark Light Button
- 3 Fan Button
- (4) System Button
- (5) Menu Buttons Access Door
- 6 Temperature Setpoint Buttons
- (7) Menu Button
- 8 User Program Buttons

Important: The low batte

The low battery indicator is displayed when the AA battery power is low. If the user fails to replace the battery within 21 days, the thermostat display will only show the low battery indicator as a final warning before the thermostat becomes inoperable. The batteries are located on the back of the thermostat.

Removing the private label badge

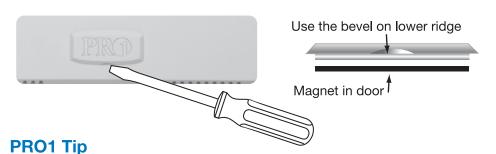

Gently slide a screwdriver into the bottom edge of the badge. Gently turn the screwdriver counter clockwise. The badge is held on by a magnet. The badge should pry off easily. **Do not use force.**

All Pro1 thermostats use the same universal magnetic badge.

Visit our website at www.pro1iaq.com to learn more about our free private label program.

SUBBASE INSTALLATION



Caution: Electrical Hazard

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.



Mercury Notice:

All of Pro1's products are mercury free. However, if the product you are replacing contains mercury, dispose of it properly. Your local waste management authority can give you instructions on recycling and proper disposal.

For vertical mount put one screw top and one screw bottom. Vertical mount For horizontal mount put one screw left and one screw right. 同 同 **UP** Horizontal mount Horizontal mount 個 ГД Vertical mount



Caution: Electrical Hazard

Failure to disconnect the power before beginning to install this product can cause electrical shock or equipment damage.




Warning:

All components of the control system and the thermostat installation must conform to Class II circuits per the NEC Code.

Wiring

- 1. If you are replacing a thermostat, make note of the terminal connections on the thermostat that is being replaced. In some cases the wiring connections will not be color coded. For example, the green wire may not be connected to the **G** terminal.
- 2. Loosen the terminal block screws. Insert wires then retighten terminal block screws.
- 3. Keep wires in shaded image as shown by pushing wires into wall opening.
- 4. Place nonflammable insulation into wall opening to prevent drafts.

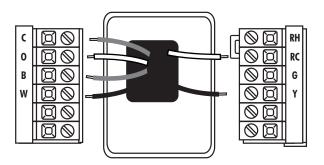

Terminal Designations

- W Heat relay
- Y Compressor relay
- G Fan relay
- Heat pump changeover valve energized in cooling
- **RC** Transformer power for cooling

- **RH** Transformer power for heating
- B Heat pump changeover valve energized in heating
- C Common wire from secondary side of cooling system transformer or for heat only system transformer

PRO1 Tips:

RH & RC terminals

For single transformer systems, leave the jumper wire in place between RH and RC. Remove jumper wire for two transformer systems.

Heat pump systems

If wiring to a heat pump, use a small piece of wire (not supplied) to connect terminals W and Y.

C terminal

The C (common wire) terminal does not have to be connected when the thermostat is powered by batteries.


Wire specifications

Use shielded or non-shielded 18 - 22 gauge thermostat wire.


WIRING DIAGRAMS

- Power supply
- Factory-installed jumper. Remove only when installing on 2-transformer systems.
- Use either O or B terminals for changeover valve.
- Use a small piece of wire (not supplied) to connect W and Y terminals.
- **Set** fan operation switch to electric
- Optional 24 VAC common connection when thermostat is used in battery power mode.


Typical 1H/1C system: 1 transformer

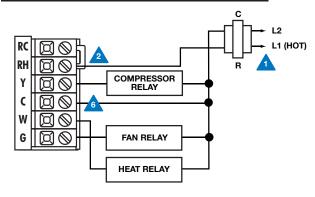


Typical 1H/1C heat pump system

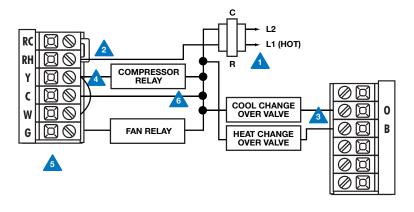


Typical heat-only system with fan

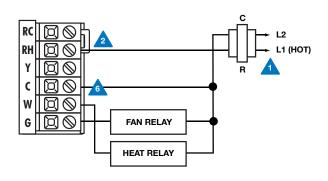


Typical 1H/1C system: 2 transformer

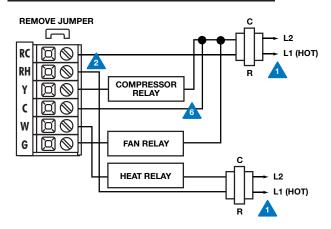

Typical heat-only system

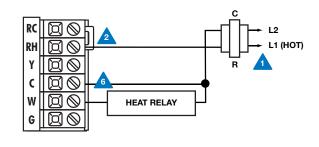

Typical cool-only system

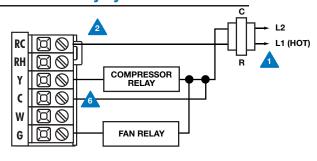

Technician Setup Menu

This thermostat has a technician setup menu for easy installer configuration. To set up the thermostat for your particular application:

- 1. Press **MENU** button
- 2. Press and hold **TECHNICIAN SETUP** button for 3 seconds. This 3 second delay is designed so that homeowners do not accidentally access the installer settings.
- 3. Configure the installer options as desired using the table below.

Use the + or - keys to change settings and the **NEXT STEP** or **PREV STEP** key to move from one option to another. **Note:** Only press **DONE** key when you want to exit the Technician Setup options.

Tech Setup S	teps					
Filter Change Reminder	Room Temperature Calibration	Minimum Compressor On Time	Compressor Short Cycle Delay	Cooling Swing	Heating Swing	Keypad Lockout
This feature will flash FILT in the display after the elapsed run time to remind the user to change the filter. A setting of OFF will disable this feature.	This feature allows the installer to change the calibration of the room temperature display. For example, if the thermostat reads 70° and you would like it to read 72° then select +2.	This feature allows the installer to select the minimum run time for the compressor. For example, a setting of 4 will force the compressor to run for at least 4 minutes every time the compressor turns on, regardless of the room temperature.	The compressor short cycle delay protects the compressor from "short cycling". This feature will not allow the compressor to be turned on for 5 minutes after it was last turned off.	The swing setting, often called "cycle rate", "differential" or "anticipration" is adjustable. A smaller swing setting will cause more frequent cycles and a larger swing setting will cause fewer cycles.	The swing setting, often called "cycle rate", "differential" or "anticipation" is adjustable. A smaller swing setting will cause more frequent cycles and a larger swing setting will cause fewer cycles.	Keypad lockout allows you to configure the thermostat so that none or some of the keys do not function.
LCD Will Show						
OFF SE Date on the late	C RL C,	OFF An	OFF OF	8F CO 0.5	dFHE	U.S. CALF
Adjustment Options						
You can adjust the filter change reminder from OFF to 2000 hours of runtime in 50 hour increments.	You can adjust the room temperature display to ready -4°F to +4°F above or below the factory calibrated reading.	You can select the minimum compressor run time from "off", "3", "4", or "5" minutes. If 3, 4, or 5 is selected, the compressor will run for at least the selected time before turning off.	Selecting ON will not allow the compressor to be turned on for 5 minutes after the last time the compressor was on. Select OFF to remove this delay.	The cooling swing setting is adjustable from ±0.4°F to ±2°F. For example: A swing setting of 0.5°F will turn the cooling on at approximately 0.5°F above the setpoint and turn the cooling off at approximately 0.5°F below the setpoint.	The heating swing setting is adjustable from ±0.4°F to ±2°F. For example: A swing setting of 0.5°F will turn the heating on at approximately 0.5°F below the setpoint and turn the heating off at approximately 0.5°F above the setpoint.	Pick PA or FU PA = partial keypad lockout, which locks all the keys except the + or - keys. FU = Full keypad lockout, which locks out all the keys. Note: Keypad lockout instructions are below
Factory Default Setting	js –					
OFF	0 °F	OFF	ON	0.4 °F	0.5 °F	NA

Note: To lock the keypad hold down the + and - keys for 3 seconds. You will see a lock in the display. To unlock the keypad hold down the + and - keys for 3 seconds.



TECHNICIAN SETUP MENU

Heating Temperature Setpoint Limit	Cooling Temperature Setpoint Limit	°F or °C	12 or 24 Hour Clock	Fan Operation	Morning Recovery	Program Options
This feature allows you to set a maximum heat setpoint value. The setpoint temperature cannot be raised above this value.	This feature allows you to set a minimum cool setpoint value. The setpoint temperature cannot be lowerd below this value.	Select F for Fahrenheit temperature read out or select C for Celsius read out	You can select either a 12 or 24 hour clock setting.	Select GAS for systems that control the fan during a call for heat. Select ELEC to generate the fan when the fan relay is connected to the G terminal.	This feature turns your system on before the WAKE programming time to ensure the enviroment is at the WAKE setpoint when the WAKE time period begins. This recovery changes over time based on the previous days experience.	You can configure this thermostat to have a 7 day program, a 5+1+1 program or nonprogrammable.
.CD Will Show						
40 HE	E C C C C C C C C C C C C C C C C C C C	OF OB OF	HSH and the same	ELE make and	ON 150 has long	Sd meno resue sus
Adjustment Options						
Jse the + or - cey to select the naximum heat etpoint.	Use the + or - key to select the minmum cool setpoint.	°F for Fahrenheit °C for Celsius	Use the + or - key to select 12 or 24 hour clock.	GAS or ELEC	Use the + or - key to turn on or off.	Use the + or - key to select 7d for 7 day, 5d for 5+1+1 or 0d for nonprogammable.
actory Default Settings						
90 °F	44 °F	°F	12 Hour Clock	GAS	ON	5d



PRO1 Tip

Temperature swing, sometimes called differetial or cycle rate, can be customized for this individual application. For most applications choose a swing setting that is as long as possible without making the occupants uncomfortable.

TECHNICIAN SETUP MENU

Tech Setup Ste	ps (Continued fi	om the previous	page)
Display Light	Contractor Call Number	Веер	System Switch
The display light can be configured to come on when any key is pressed or only when the light key is pressed.	Allows you to put your phone number in the display. You can choose ON or OFF	When any key is pressed an audible beep will sound. There is an ON or an OFF.	You can configure the system switch for the particular application: Heat - Off - Cool, Heat - Off, Cool - Off, Heat - Off - Cool - Auto
LCD Will Show			
	OFF UKL Med State - State - State -	00 b	meter Audo das 😤
Adjustment Options			
OFF configures display light to come on only with the light key, which will save battery power. ON configures the display light to come on when any key is pressed.	If selected on, you will see the input screen after pressing next step. Use the + or - key until the desired number and the FAN or SYSTEM key to move from one character to another. See note below on operation.	If ON is selected the beep will sound. If OFF is selected, there is no sound.	Use the + or - key until the desired application is flashing.
Factory Default Settings			
ON	OFF	ON	Heat - Off - Cool

Note: If Contractor Call Number is selected **ON**, your phone number will show in the display if there has been a continuous call for heating or cooling for 24 hours or if the light button is held down for 3 seconds. To remove the phone number from the display, hold the light button down for 3 seconds.

MOUNT THERMOSTAT & BATTERY INSTALLATION


Mount Thermostat

Align the 4 tabs on the subbase with corresponding slots on the back of the thermostat, then push gently until the thermostat snaps in place.



Battery Installation

Battery installation is optional if thermostat is hardwired (C terminal connected).





On the back of the thermostat insert 2 AA Alkaline batteries (included).

PROGRAMMING THE THERMOSTAT

Set Time

Follow the steps below to set the day of the week and current time:

- 1. Press MENU
- 2. Press SET TIME
- 3. Day of the week will be flashing. Use the + or key to select the current day of the week.
- 4. Press **NEXT STEP**
- 5. The current hour is flashing. Use the + or key to select the current hour. When using 12-hour time, make sure the correct a.m. or p.m. choice is selected.
- 6. Press **NEXT STEP**
- 7. Minutes are now flashing. Use the + or key to select current minutes
- 8. Press **DONE** when completed

Programming

All programmable Pro1 thermostats are shipped with an energy saving pre-program. You can customize this default program by following the Set Program Schedule.

Your thermostat can be programmed to have each day of the week programmed uniquely (7 days), all the weekdays the same, a separate program for Saturday, and a separate program for Sunday (5+1+1), or non-programmable. This thermostat has a programmable fan feature, which allows you to run the fan continuously during any time period. There are four time periods for each program (WAKE, LEAVE, RETURN, SLEEP).

	Factory Default Program				
Day of the Week	Events	Time	Setpoint Temperature (Heat)	Setpoint Temperature (Cool)	
Weekday	Wake 🔏	6 a.m.	70° F (21° C)	75° F (24° C)	
	Leave 4	8 a.m.	62° F (17° C)	83° F (28° C)	
	Return in the	6 p.m.	70° F (21° C)	75° F (24° C)	
	Sleep 📸	10 p.m.	62° F (17° C)	78° F (26° C)	
Saturday	Wake 🕌	8 a.m.	70° F (21° C)	75° F (24° C)	
	Leave 4	10 a.m.	62° F (17° C)	83° F (28° C)	
	Return i	6 p.m.	70° F (21° C)	75° F (24° C)	
	Sleep 👚	11 p.m.	62° F (17° C)	78° F (26° C)	
Sunday	Wake 🕌	8 a.m.	70° F (21° C)	75° F (24° C)	
	Leave 4	10 a.m.	62° F (17° C)	83° F (28° C)	
	Return +	6 p.m.	70° F (21° C)	75° F (24° C)	
	Sleep 🕌	11 p.m.	62° F (17° C)	78° F (26° C)	

PROGRAMMING THE THERMOSTAT

You can use the table below to plan your customized program schedule if using 5+1+1.

		Programmin	g Table	
Day of the Week	Events	Time	Setpoint Temperature (Heat)	Setpoint Temperature (Cool)
Weekday	Wake 🔏 👚			
	Leave diff			
	Return in			
	Sleep 👚			
Saturday	Wake 🔏 🕆			
	Leave (iff			
	Return in			
	Sleep 👚			
Sunday	Wake 🚮			
	Leave (iff			
	Return in			
	Sleep 👚			

Set Program Schedule

To customize your 5+1+1 program schedule, follow these steps Weekday:

- Select HEAT or COOL using the SYSTEM key. Note: You have to program heat and cool each separately.
- 2. Press MENU
- 3. Press **SET SCHED**. Note: Monday-Friday is displayed and the **WAKE** icon is shown. You are now programming the **WAKE** time period for the weekday setting.
- 4. Time is flashing. Use the ____ or ___ key to make your time selection for the weekday **WAKE** time period. Note: If you want the fan to run continuously during this time period, select **ON** with the **FAN** key.
- 5. Press **NEXT STEP**
- 6. The setpoint temperature is flashing. Use the + or key to make your setpoint selection for the weekday **WAKE** period.
- 7. Press **NEXT STEP**
- Repeat steps 4 through 7 for weekday LEAVE time period, for weekday RETURN time period, and for weekday SLEEP time period.

Saturday:

 Repeat steps 4 through 7 for Saturday WAKE time period, for Saturday LEAVE time period, for Saturday RETURN time period, and for Saturday SLEEP time period.

Sunday:

10. Repeat steps 4 through 7 for Sunday WAKE time period, for Sunday LEAVE time period, for Sunday RETURN time period, and for Sunday SLEEP time period.

PROGRAMMING THE THERMOSTAT

To customize your 7 day program schedule, follow these steps:

- 1. Select **HEAT** or **COOL** using the system key. You have to program heat and cool each separately.
- 2. Press MENU
- 3. Press SET SCHED

Note: Monday is displayed and the **WAKE** icon is shown. You are now programming the **WAKE** time period for the Monday setting.

- 4. Time is flashing. Use the + or key to make your time selection for the Monday **WAKE** time period. **Note:** If you want the fan to run continuously during this time period, select **ON** with the **FAN** key.
- 5. Press **NEXT STEP**
- 6. The setpoint temperature is flashing. Use the + or key to make your setpoint selection for the Monday **WAKE** period.
- 7. Press **NEXT STEP**
- 8. Repeat steps 4 thru 7 for Monday **LEAVE** time period, for Monday **RETURN** time period, and for Monday **SLEEP** time period.

Tuesday, Wednesday, Thursday, Friday, Saturday, Sunday

Repeat steps 4 thru 7 for the remaining days of the week.

A Note About Auto Changeover:

Auto changeover will switch between heating and cooling as needed. It is very important to make sure the cooling setpoint temperature is at least 3° above the heating setpoint temperature and that the heating setpoint temperature is at least 3° below the cooling setpoint temperature.

A Note About Programmable Fan:

The programmable fan feature will run the fan continuously during any time period it is programmed to be on. This is the best way to keep the air circulated and to eliminate hot & cold spots in your building.

SPECIFICATIONS & CONTACT INFORMATION

Specifications

The display range of temperature	41°F to 95°F (5°C to 35°C)
The control range of temperature	44°F to 90°F (7°C to 32°C)
Load rating	1 amp per terminal, 1.5 amp maximum all terminals combined
Display accuracy	± 1°F
Swing (cycle rate or differential)	Heating is adjustable from 0.4°F to 2.0°F
	Cooling is adjustable from 0.4°F to 2.0°F
Power source	18 to 30 VAC, NEC Class II, 50/60 Hz for hardwire (common wire)
	Battery power from 2 AA Alkaline Energizer batteries
Operating ambient	32°F to +105°F (0° to +41°C)
Operating humidity	90% non-condensing maximum
Dimensions of thermostat	4.7"W x 4.4"H x 1.1"D

Contact Us

Pro1 IAQ Inc.

2626 W. College Rd. Springfield, MO 65802

Toll-free: 1-888-Pro1iaq (776-1427) **Web:** http://www.pro1iaq.com

Hours of Operation:

Monday - Friday 9 AM - 6 PM Eastern